


NEW SCANDIA TOWNSHIP - SOILS RESTRICTIVE TO SEPTIC SYSTEMS

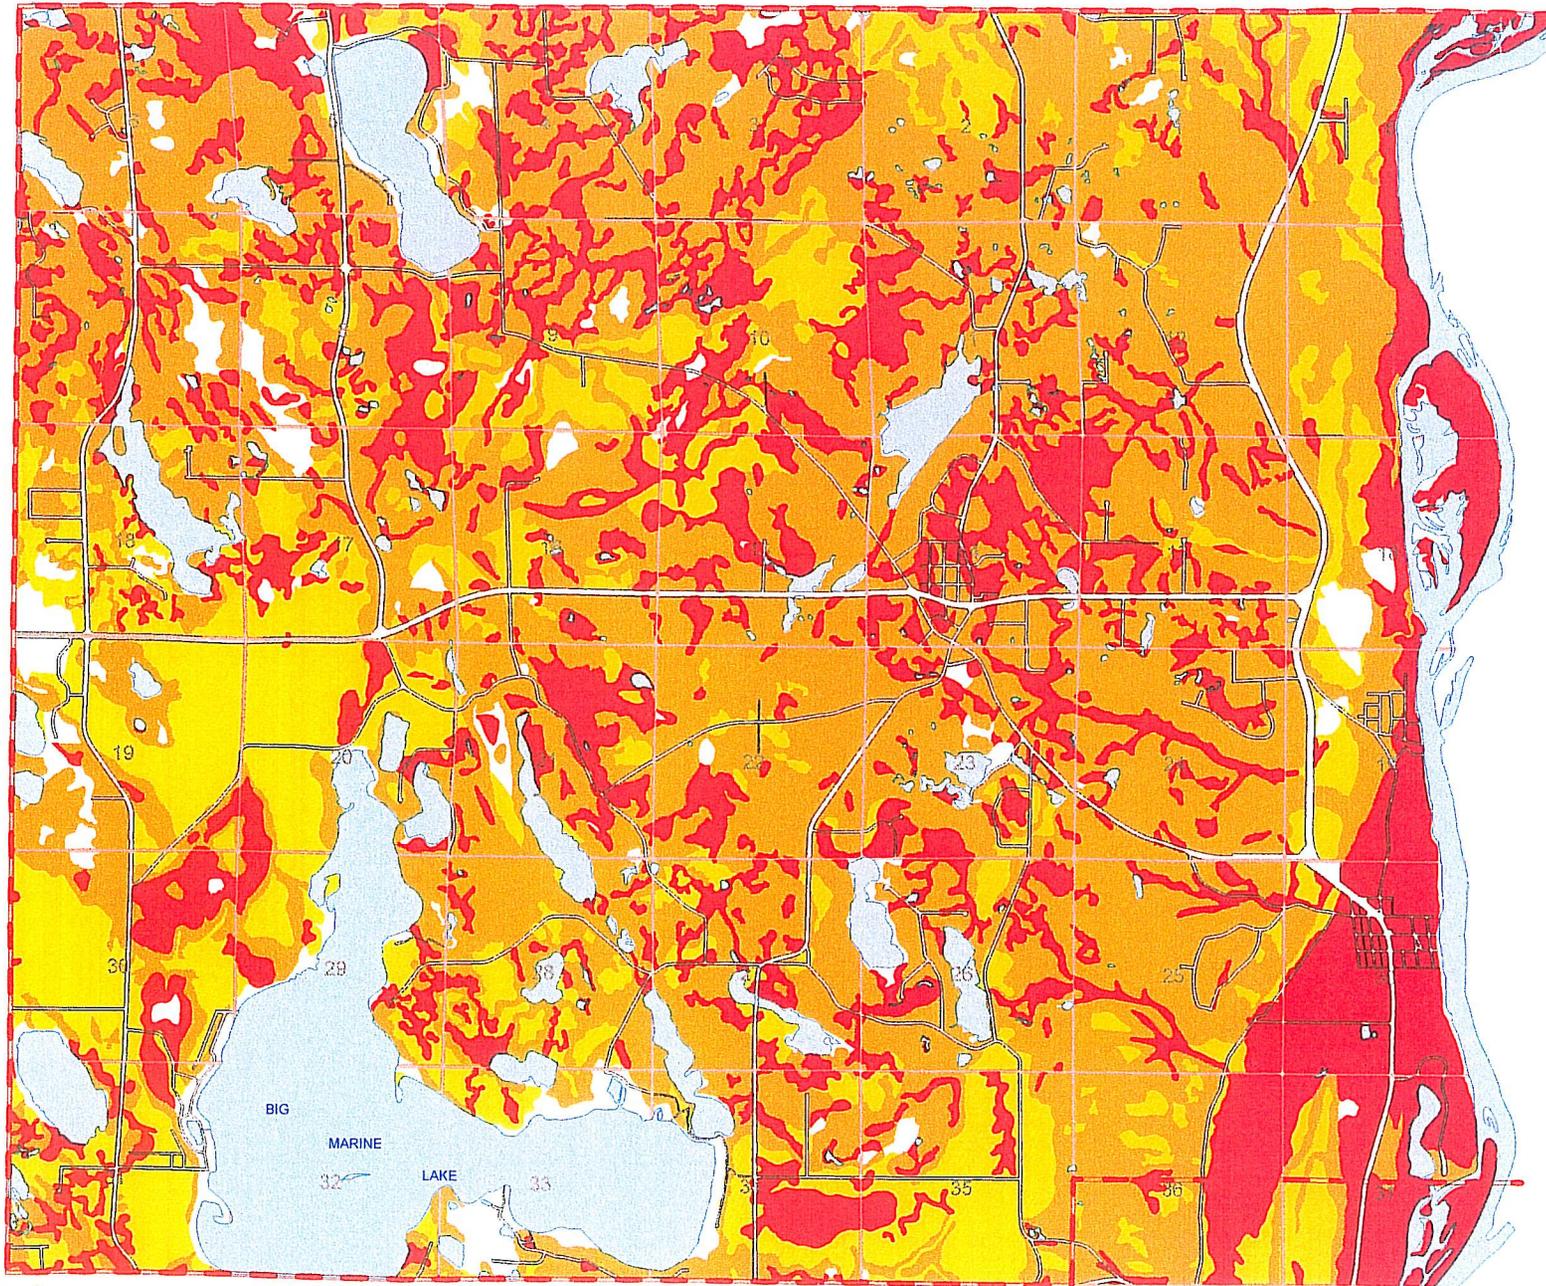

LEGEND:


Soil Rating for Septic Tank Absorption Fields:

- Severe
- Moderate
- Slight
- Not Rated
- Water
- Section Lines
- Township Boundary

Soil information taken from the Washington County Soils Survey with modifications by the Washington County Health Department.



April 28, 1997



Sources:
Washington County:
 Surveyor's Office - H.E.L.M. Office
 U.S. Department of Agriculture
 Peggy Reichert
 & Associates, Inc. *PlanSight*
GIS & PLANNING TECHNOLOGIES